中国认可
国际互认
检测
TESTING
CNAS L1978

190000122473

检 测 报 告
TEST REPORT

报 告 编 号:
REPORT NO. : 25202003691

样 品 名 称:
NAME OF SAMPLE: 哑面釉面砖
GLAZED PORCELAIN TILE

委 托 单 位:
APPLICANT: 佛山昇特建材有限公司
FOSHAN CENTRA BUILDING MATERIAL CO., LTD

检 验 日 期:
DATE OF TEST: 11/09/2020 – 17/09/2020 (dd/mm/yy)

国 家 建 筑 卫 生 陶 瓷 检 测 重 点 实 验 室
STATE KEY TESTING LABORATORY OF BUILDING CERAMICS AND SANITARY WARE
佛 山 海 关 综 合 技 术 中 心
COMPREHENSIVE TECHNOLOGY CENTRE OF FOSHAN CUSTOMS

佛 山 海 关 综 合 技 术 中 心
COMPREHENSIVE TECHNOLOGY CENTRE OF FOSHAN CUSTOMS

检 测 报 告
TEST REPORT


报告编号：25202003691
Report No:

样品名称 Name of sample	哑面釉面砖 GLAZED PORCELAIN TILE	名义尺寸 Nominal size	60cm×60cm
表面特性 Nature of the surface	有釉砖 Glazed (GL)	工作尺寸 Work size	—
类别 Class	P1	样品描述 Description of Samples	样品完好,适合测试 The samples are sound, intact and fit for test.
类型 Tile type	瓷质砖 Porcelain tile	等级 Grade	—
样品标记 Mark of samples	FQ60M008	样品数量 Quantity of samples	15 片 15 Pieces
委托单位 Applicant	佛山昇特建材有限公司 FOSHAN CENTRA BUILDING MATERIAL CO., LTD	委托单位地址 Address of applicant	佛山市禅城区南庄镇季华西路 78 号佛山国际陶瓷卫浴城 A 区 4 座 09 号 NO.9, BUILDING A4, FOSHAN INTERNATIONAL CERAMIC & SANITARY CITY, WEST JIHUA ROAD, NANZHUANG TOWN, CHANCHENG DISTRICT, FOSHAN CITY, CHINA
委托单位电话 Telephone of applicant	86-13824545887	委托单位传真 Fax of Applicant	—
样品来源 Source of Samples	委托单位自送样品 Samples selected by applicant	接样日期 Received on	10/09/2020
检验依据 Test Standard	1.ANSI A 137.1-2019 *American National Standard Specifications for Ceramic Tile* 2. GB/T 5950-2008《建筑材料与非金属矿产品白度测量方法》		
检验结论 Conclusion of Test	1.样品经检验,所检验项目的检验结果符合 ANSI A 137.1-2019 标准的规定。 The results conform to the requirement of standard ANSI A 137.1-2019 with respect to the test items. 2. 白度的检验结果见报告第 4 页。 The test results of *whiteness* see Page 4.		
检验单位盖章 Stamp of Test Unit	日期：18/09/2020 Date:	检验单位联系方式 Address of Test Unit	地址：广东省佛山市禅城区魁奇一路澜石（国际）金属交易中心十八座二楼 Address : 2/F, Building 18, Lanshi International Metal Exchange Center, Kuiqiyi Road, Chancheng District, Foshan, Guangdong, China (528000) 电话（Tel）：86-757-83960558 86-757-83827991 传真（Fax）：86-757-83827971 邮箱（E-mail）：fsiqtc@163.com 网址（url）：http://www.fsiqtc.com/
声明 Notes	1、我们已尽所知所能实施上述检验，不能因签发本报告而免除有关各方根据合同和法律所承担的责任和义务; All inspections are carried out conscientiously to the best of our knowledge and ability. This report does not in any respect absolve the other related parties from his contractual and legal obligations. 2、未经本实验室书面许可，不得部分复制本报告; This report shall not be reproduced, except in full, without the prior written approval from the issuing laboratory. 3、本报告仅是样品的检测结果。 The results in this report apply to the samples only. 4、本报告所述的样品信息为委托单位自行声明，实验室不负责其真实性。 The product information are declared by applicant，and laboratory is not responsible for the authenticity.		

检验 Tested by 杨明 审核 Inspected by 审批 批准 Approved by 肖

样品照片
Photo of Samples



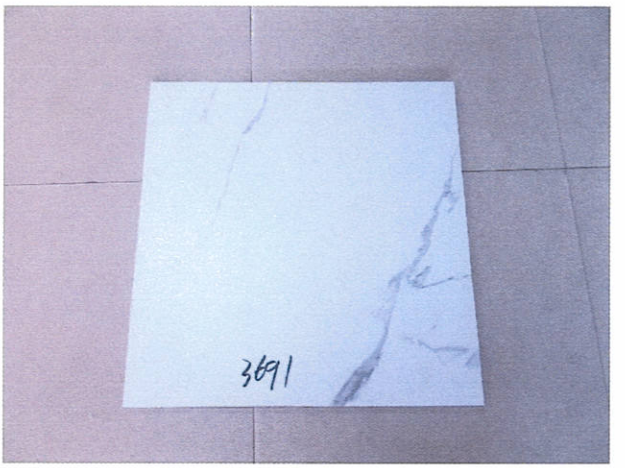

佛 山 海 关 综 合 技 术 中 心
COMPREHENSIVE TECHNOLOGY CENTRE OF FOSHAN CUSTOMS
检 测 报 告
TEST REPORT

ANSI A 137.1-2019 *American National Standard Specifications for Ceramic Tile*

条款 Clause	性能 Properties	检验方法 Test Method	要求 Requirements	检验结果 Results	判定 Verdicts
6.2.2.1.10	**摩擦系数：** 湿态动摩擦系数 **Coefficient of friction:** Wet DCOF Value	ANSI A326.3-2017	报告检验结果 As Reported	0.37	—
6.2.3.1	吸水率 **Water Absorption**	ASTM C373-18	≤0.50%	0.03%~0.05%	P
6.2.3.3	破坏强度/kN **Breaking Strength, in kN**	ASTM C648-04	平均值≥1.22 Average≥1.22	2.58	P
			单个值≥1.11 Individual≥1.11	2.49～2.64	P
6.2.3.5	表面耐磨性 **Visible Abrasion Resistance (PEI testing)**	ASTM C1027-19	报告检验结果 As Reported	Ⅳ 级 Class Ⅳ	—
6.2.3.9	耐污染性 **Stain Resistance**				
	对比砂浆 Contrasting Grout	ASTM C1378-04	报告检验结果 As Reported	无变化 Not affected	—
	碳素墨水 Carbon Lamp Black	ASTM C1378-04	报告检验结果 As Reported	无变化 Not affected	—
	防水墨水（黑色） Waterproof ink Black	ASTM C1378-04	报告检验结果 As Reported	无变化 Not affected	—
	水性油墨 Washable Ink	ASTM C1378-04	报告检验结果 As Reported	无变化 Not affected	—
	高锰酸钾溶液, 1% Potassium Permanganate Solution, 1%	ASTM C1378-04	报告检验结果 As Reported	无变化 Not affected	—
	甲基兰溶液, 1% Methylene Blue Solution, 1%	ASTM C1378-04	报告检验结果 As Reported	无变化 Not affected	—
	耐污染性等级 Stain Resistance Class	6.2.3.9	报告检验结果 As Reported	A 级 Class A	—

用语说明 Possible test case verdicts
1. P(ass)：合格 *Test item does meet the requirement.*
2. F(ail)：不合格 *Test item does not meet the requirement.*
3. —：未进行判定 *Verdict was not carried out.*
4. N/A：不适用 *Test case does not apply to the test item.*

GB/T 5950-2008《建筑材料与非金属矿产品白度测量方法》

性能 Properties	检验方法 Method	检验结果 Results
*白度 Whiteness	GB/T 5950-2008	70

带*检测项目不在 CNCA 和 CNAS 认可范围内 The properties with * are not accredited by CNCA and CNAS.

*** ***
报告结束 End of Test Report